






## Community Development and Sustainability Department


23 Russell Boulevard, Suite 2 Davis, California 95616  
Phone: (530)757-5610 Fax: (530)757-5660 TDD: (530)757-5666  
Website: [www.cityofdavis.org/CDD](http://www.cityofdavis.org/CDD)  
Email: [pbweb@cityofdavis.org](mailto:pbweb@cityofdavis.org)

# SPRINKLERS VALVES

- Metallic piping between supply water and **metallic sprinkler shut off** valve must be of similar metals (cannot use galvanized iron with copper piping) brass ok with galvanized iron or copper.
- Where exposed to sunlight, plastic pipe (PVC) shall be wrapped with at least 0.040" (1.0 mm) of tape or otherwise protected from UV degradation.
- No valves are allowed downstream of the atmospheric anti-siphon valve.
- Timers should be installed per manufactures installation instructions and the California Electric Code.

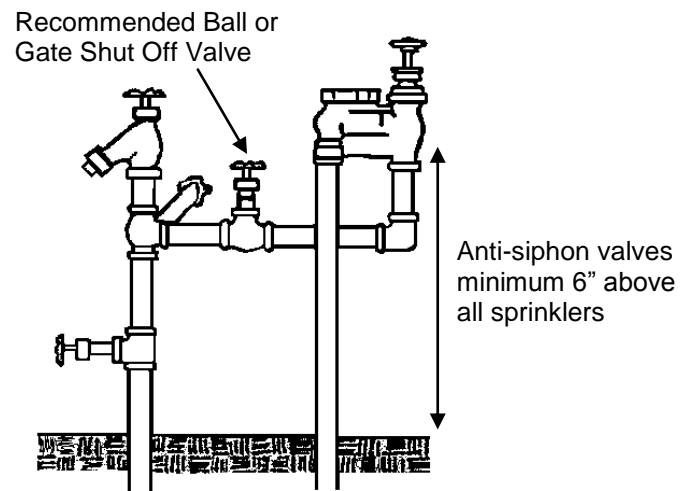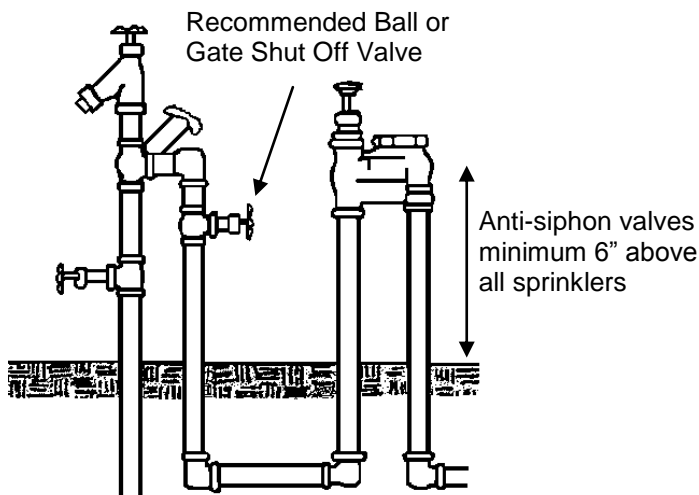

Hose Bib Back Flow Device



Hose Bib with Back Flow Device Installed

Note: All exterior receptacles must be tamper resistant, GFCI protected and have an enclosure that is weather proof whether or not the attachment plug is installed.