

NOTE:

1. SEE STANDARD SPEC. SEC. 203-4, SEE STANDARD PLAN 101-5, SHT. 3
2. SEE STANDARD SPEC 203-6. HYDRANT SHALL BE CLOW 960 OR APPROVED EQUAL, SHORT BREAK VALVE SHALL BE CLOW 400A OR APPROVED EQUAL.



3/21	Changed hydrant type				
Rev.	Description	Date	Rev.	Description	Date

CITY OF DAVIS STANDARD PLAN

APPROVED Sept 1 2021
Dianna R. Jensen
 DIANNA R. JENSEN
 P.E. No. C-56636

FIRE HYDRANT - PROFILE VIEW

SHEET 1 OF 2 101-1

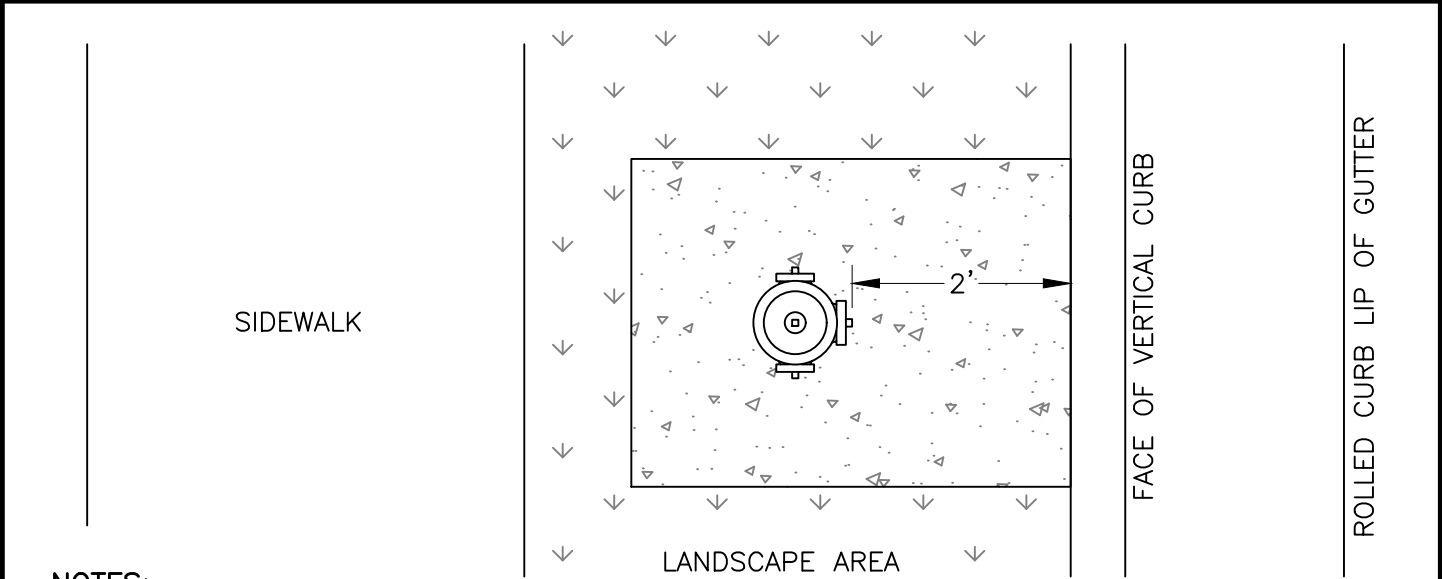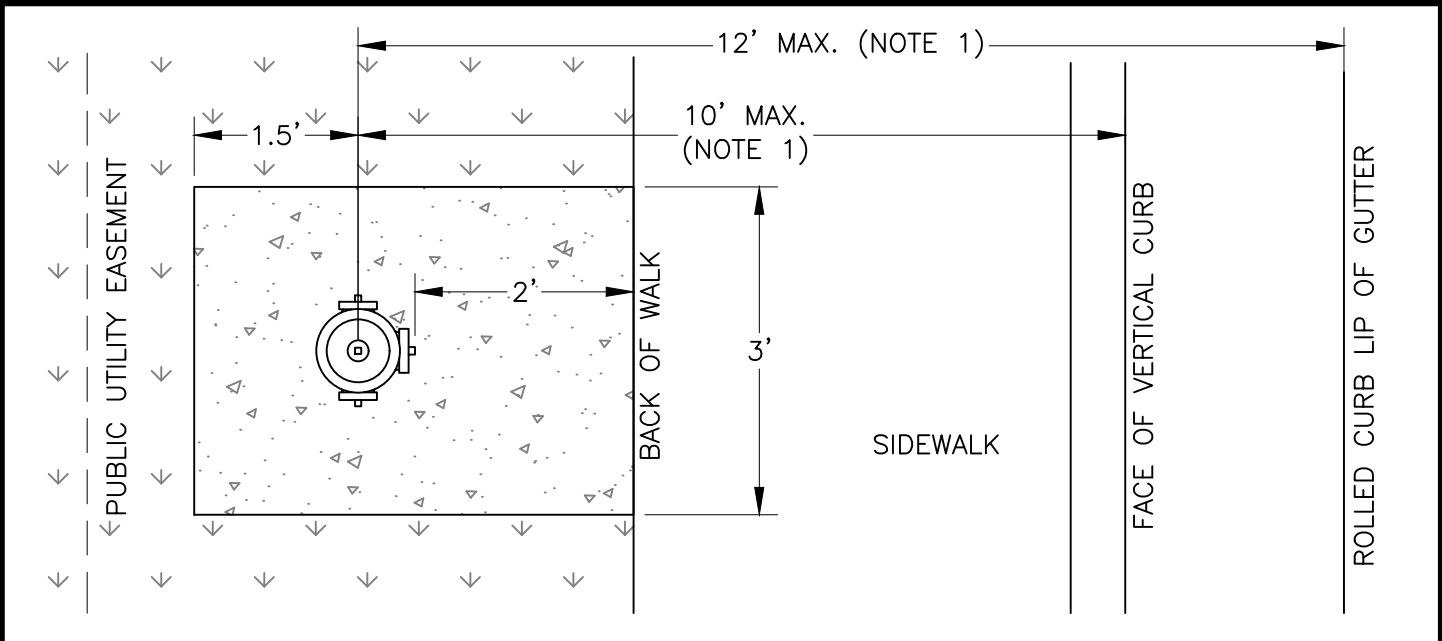

NOTES:

1. MAX. DIMENSION SHALL NOT BE EXCEEDED WITHOUT DAVIS FIRE DEPT. APPROVAL.
2. PRIOR TO ACCEPTANCE, ALL NICKS, SCRAPES, ETC. IN THE FACTORY FINISH SHALL BE PAINTED WITH APPROVED PAINT.
3. FINISH COLOR – SEE STANDARD SPEC. 203-6.5
4. PROVIDE 3' CLEARANCE AROUND FIRE HYDRANT.

Rev.	Description	Date	Rev.	Description	Date

CITY OF DAVIS STANDARD PLAN

APPROVED Sept 1 2021
Dianna R. Jensen
 DIANNA R. JENSEN
 P.E. No. C-56636

FIRE HYDRANT - PLAN VIEWS

SHEET 2 OF 2 101-1